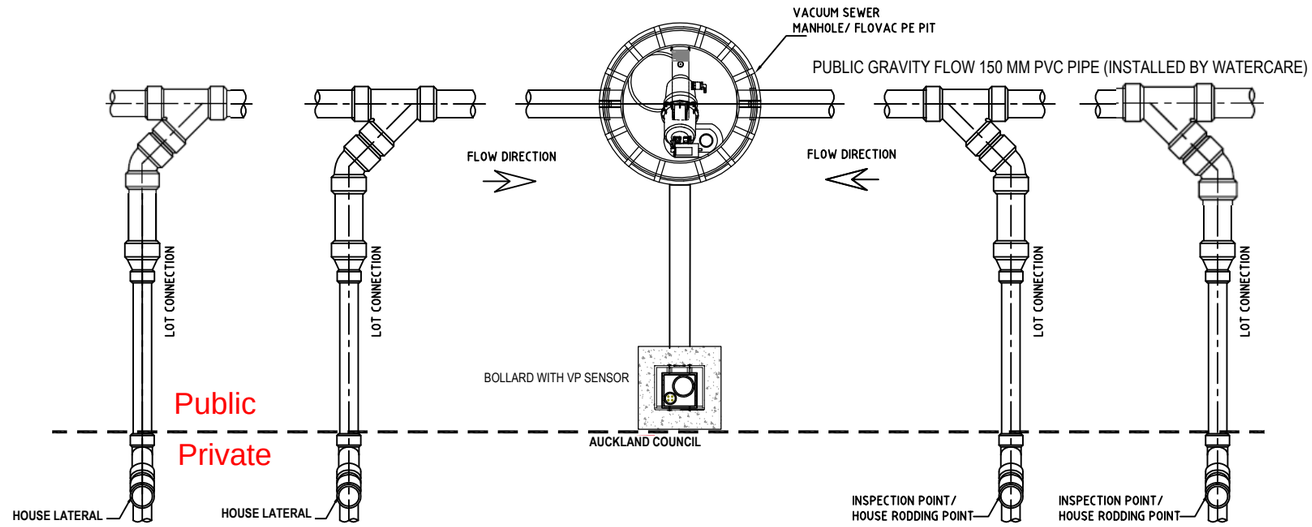

1 PLAN

NOTES:

1. ANY DISCREPANCY FOUND IN THE DRAWINGS SHOULD BE CONSULTED WITH THE ENGINEER
2. DIMENSIONS ARE IN MILLIMETERS AND LEVELS IN METRES UNLESS INDICATED OTHERWISE
3. HOUSE PLUMBING ARRANGEMENT AS PER AUCKLAND COUNCIL STANDARDS
4. WHERE 1.2 M DISTANCE FROM FFL TO SOFFIT IS NOT MET, A PRIVATE PUMP IS REQUIRED.

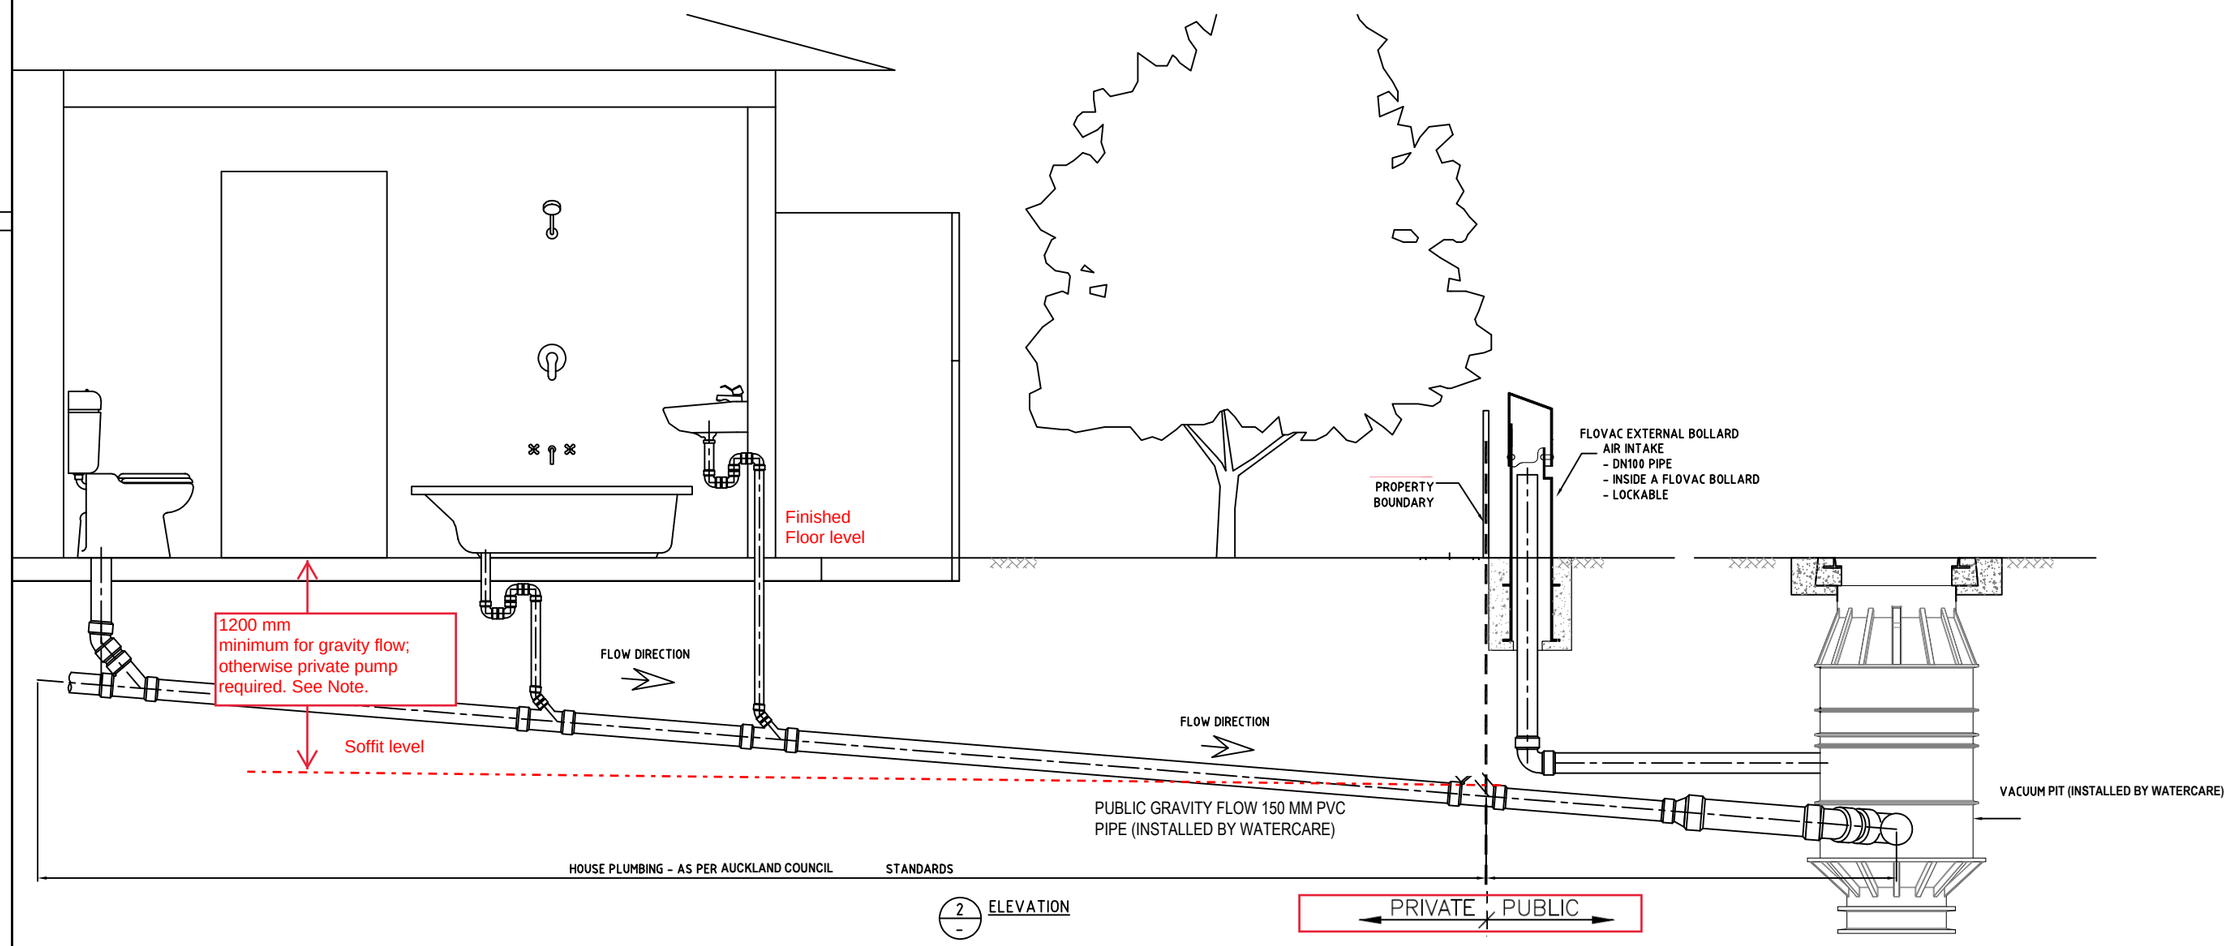

2 ELEVATION

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
B	25.03.14		UPDATED VENTING OPTIONS	CG	CE	RW/DS

DESIGN SURVEY NONE	VERTICAL DATUM NONE	DES CALC
	COORDINATE SYS NONE	DES CHD
ASCON SURVEY NONE	DES REF	DRN
		Q.C. CHD

NORTH POINT

CLIENT: Watercare

COPYRIGHT
THE CONCEPT AND INFORMATION CONTAINED IN THIS DOCUMENT IS THE COPYRIGHT OF FLOVAC SYSTEMS PTY LTD. USE OR COPYING OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION OF FLOVAC SYSTEMS CONSTITUTES INFRINGEMENT OF COPYRIGHT.

VACUUM SEWERAGE SPECIALIST:
FLOVAC SYSTEMS
FLOVAC VACUUM SEWERAGE SYSTEMS PTY LTD
UNIT 1, 43-51 COLLEGE STREET GLADESVILLE, NSW AUSTRALIA 2111
TEL (+61 2) 9817 7035 FAX (+61 2) 9817 3430 EMAIL INFO@FLOVAC.COM

FLOVAC STANDARD DRAWINGS
RETICULATION NETWORK
INTERFACE OF HOUSE CONNECTION TO **PUBLIC** SEWER

FILE	DRAWING NO.:	ISSUE
PROJECT	FVS-STD-800-001	B

ORIGINAL SHEET SIZE A1
SCALE NTS

Z:\FLOVAC PROJECTS\NZ Clevedon\Design Output\Issued for Construction\Report\2020-02-03 FDP IFC Report\Drawings\FVS-STD-800-001 Rev B Vacuum - Gravity Interface New Zealand.dwg

566
810